

ACT-H

Circular motorised damper



ACT-H series are circular motorised dampers to regulate air flow in duct systems. The damper blade position can be regulated via an analogue / modulating input or via Modbus RTU communication. The supply voltage is 24 VDC. All parameters are accessible via Modbus RTU communication.

Key features

- Wiring via spring contact terminal block or via RJ45 connector
- Adjustable maximum and minimum position of the damper blade
- Analogue/modulating input to control blade position in stand-alone mode
- Dedicated Holding register for setting blade position in Modbus mode
- Zero position recalibration via Modbus RTU
- Fits circular air ducts with standard dimensions
- Compatible with SenteraWeb for remote control and online monitoring
- Modbus RTU communication and analogue input
- Easy to install


Area of use

- Control air volume flow in air ducts
- Control fresh air supply for each room separately
- Building and controlled ventilation

Article codes

Article code	Compatible duct diameter	Imax	Connection type
ACT-H-125	125 mm	100 mA	RJ45 or terminal block

Indications

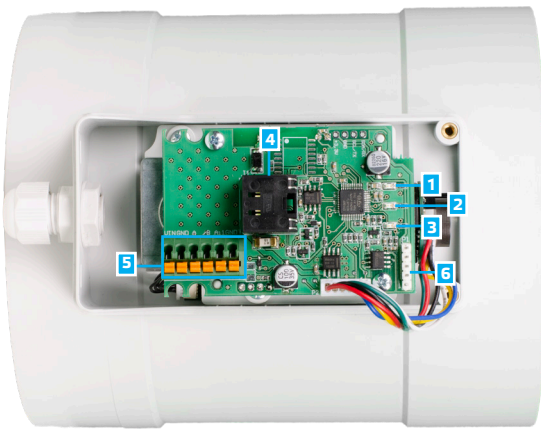

1 - Green LED 1	On	The damper is closed (damper blade at minimum position)
2 - Green LED 2	Blinking	Indicates normal operation of the damper
3 - Green LED 3	On	The damper is open (damper blade at maximum position)
4 - RJ45 socket		Modbus RTU communication and 24 VDC power supply can be connected via the RJ45 socket
5 - Terminal block		Modbus RTU communication, 24 VDC power supply and the control input can be connected via the terminal block
6 - PROG header, P1		Put a jumper onto pins 1 and 2 and wait for at least 15 seconds to reset the Modbus communication parameters
		Put a jumper onto pins 3 and 4 and restart the supply to enter bootloader mode

Note: When the actuator is in bootloader mode, LED 3 is flashing. During the firmware upload, LED 2 and LED 3 are flashing simultaneously.



Wiring diagram

RJ45 socket (Power over Modbus)

Pin 1	24 VDC	Supply voltage, 24 VDC
Pin 2		
Pin 3	A	Modbus RTU communication, signal A
Pin 4		
Pin 5	/B	Modbus RTU communication, signal /B
Pin 6		
Pin 7	GND	Supply voltage, ground
Pin 8		



Terminal block

VIN	Supply voltage 24 VDC
GND	Supply voltage, ground
A	Modbus RTU communication, signal A
/B	Modbus RTU communication, signal /B
Ai1	Analogue /modulating input (0–10 VDC / 0–20 mA / PWM)
GND	Ground, Ai1

Attention! The damper needs to be supplied via the RJ45 connector or via the terminal block. Do not connect supply voltage to both simultaneously!

Modbus registers



The Sensstant Modbus configurator allows you to easily monitor and/or configure Modbus parameters.

The parameters of the unit can be monitored / configured through the 3SMoDUS software platform. You can download it from the following link:

<https://www.sentera.eu/en/3SMCenter>



For more information about the Modbus registers, please refer to the product Modbus Register Map.


ACT-H

Circular motorised damper




Operational diagram

Standalone mode

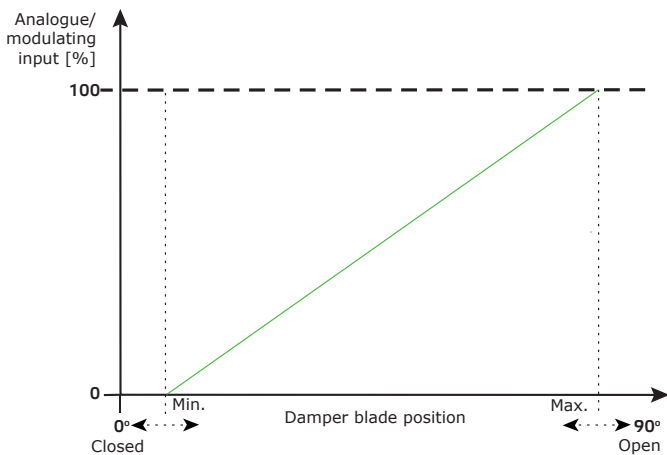


Modbus mode

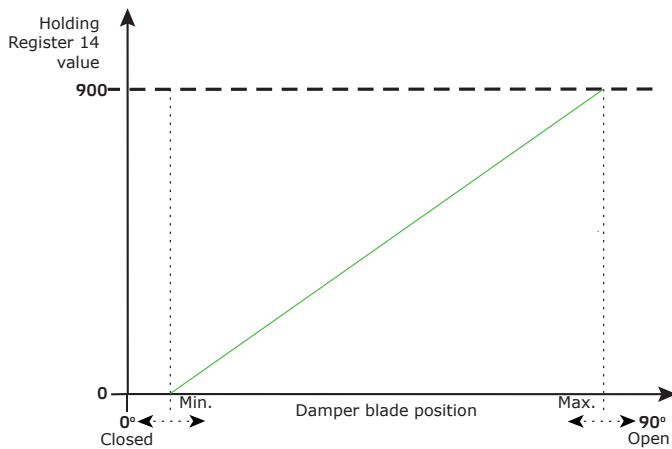


Attention! The minimum open and the maximum closed position of the damper depend on the values set in Modbus Holding registers 17 and 18.


Fixing and dimensions ACT-H-125

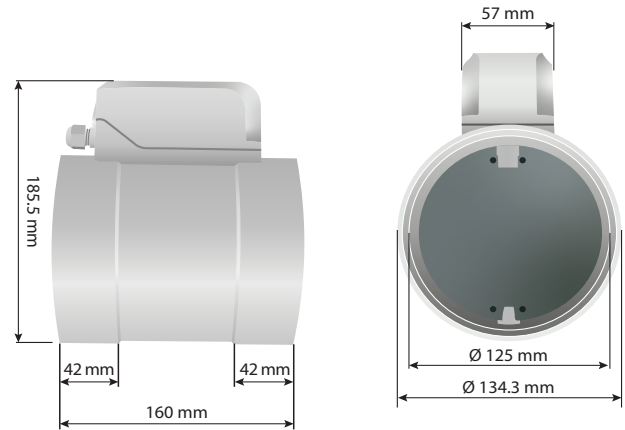

Fixing and dimensions ACT-H-160

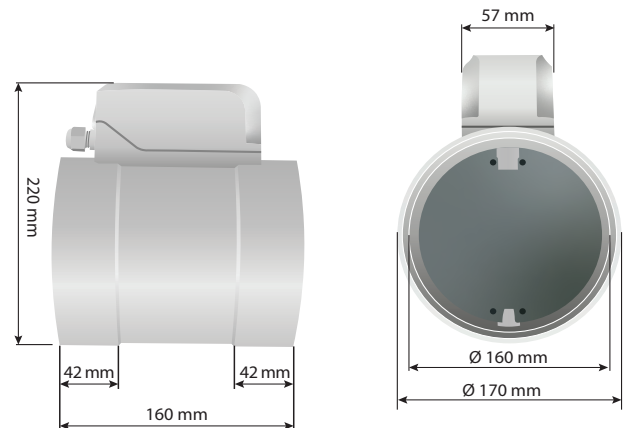

Standards

- 
 Machinery Directive 2006/42/EU:
 - EN 13141-2:2010 Ventilation for buildings — Performance testing of components/ products for residential ventilation — Part 2: Exhaust and supply air terminal devices
 - EN ISO 12100:2010 Safety of machinery — General principles for design — Risk assessment and risk reduction
 - EN 1751:2014 Ventilation for buildings. Air terminal devices. Aerodynamic testing of damper and valves
- Low voltage (LVD) directive 2014/35/EU:
 - EN 60204-1:2018 Safety of machinery — Electrical equipment of machines — Part 1: General requirements
- Electromagnetic compatibility (EMC) directive 2014/30/EU:
 - EN 61000-6-2:2005 Electromagnetic compatibility (EMC) — Part 6-2: Generic standards — Immunity for industrial environments Amendment AC:2005 to EN 61000-6-2
 - EN 61000-6-3:2007 Electromagnetic compatibility (EMC) — Part 6-3: Generic standards — Emission standard for residential, commercial and light-industrial environments Amendments A1:2011 and AC:2012 to EN 61000-6-3
- WEEE 2012/19/EU
- RoHS Directive (2011/65/EU incl. 2015/863/EU) REACH Regulation (1907/2006)

ACT-H

Circular motorised damper




Technical specifications

Supply voltage	24 VDC (PoM or terminal block)
Minimum damper position (closed)	0°
Maximum damper position (open)	90°
Analogue / modulating input	0–10 VDC mode, ($R_L \geq 50 \text{ k}\Omega$)
	0–20 mA mode, ($R_L \leq 500 \Omega$)
	PWM (open-collector type) mode: 1 kHz, ($R_L \geq 50 \text{ k}\Omega$), PWM voltage level: 3,3 VDC or 12 VDC
Maximum input current consumption	100 mA
Airflow velocity range	0–10 m/s
Airtightness damper blade	Class 4 (according to EN1751)
Airtightness casing	Class D (according to EN1751)
Operating temperature range	5–65 °C
Operating humidity range	5–85 % rH, non-condensing
Protection standard	IP54 (according to EN 60529)
Enclosure material	ABS 10 GF

Attention! To guarantee airtightness, the transition between duct and damper needs to be sealed with aluminium foil tape.

Packaging



Article	Packaging	A [mm]	B [mm]	C [mm]	Net weight	Gross weight
ACT-H-125	Unit (1 pc.)	160	134,3	185,5	0,60 kg	0,82 kg

Global trade item numbers (GTIN)

Packaging	ACT-H-125
Unit	05401003018316