



## DRM-M-02

### Modbus I/O module with 2 relay outputs

DRM-M-02 are relay output modules for Modbus networks. They feature 2 C/O relays with a normally open and normally closed contact. The status of the relays can be controlled by Modbus RTU communication.

#### **Key features**

- 2 C/O relays with a normally open and normally closed contact
- Modbus RTU communication
- DIN rail mountable
- Firmware updates can be pushed via Modbus RTU communication (integrated

	Tecl	nnical specifications
Supply voltage	24 VDC PoM	
Maximum current consumption	60 mA	
Maximum switching voltage	220 VDC / 250 VAC	
Maximum switching current	5 A (resistive load)	
Protection class	IP30 (EN 60529)	
Ambient conditions	Operating temperature	-20—60 °C
	Relative humidity	5—90 % rH, non-condensing

#### Area of use


- · For indoor use only.
- · Control external devices via the relay outputs
- The Modbus master can adjust the relay status via the Modbus registers

		Article codes
DRM-M-02	2 C/O relay outputs	

#### **Standards**

- Low Voltage Directive 2014/35/EU
- EN 50178:1997 Electronic equipment for use in power installations
   EN 60529:1991 Degrees of protection provided by enclosures (IP Code).
- Amendment AC:1993 to EN 60529
- EMC directive 2014/30/EU:
   EN 61000-6-2:2005 Electromagnetic compatibility (EMC) Part 6-2: Generic standards - Immunity for industrial environments. Amendment AC:2005 to EN
  - EN 61000-6-4:2007 Electromagnetic compatibility (EMC) Part 6-4: Generic standards - Emission standard for industrial environments Amendment A1:2011 to EN61000-6-4
- RoHs Directive 2011/65/EU
  - EN IEC 63000:2018 Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances



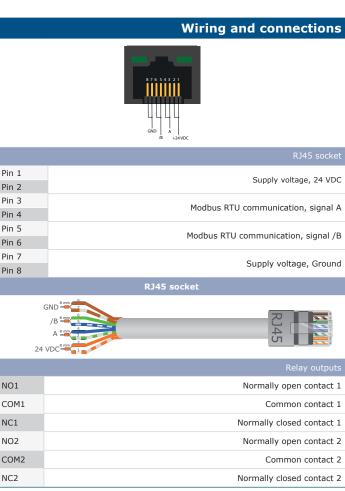







## DRM-M-02

## Modbus I/O module with 2 relay outputs

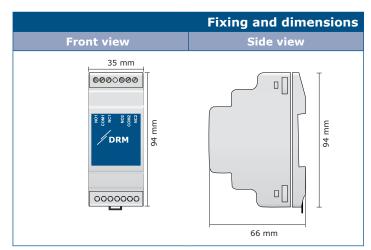

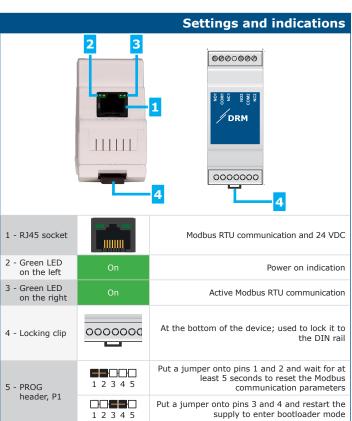



#### Modbus registers



Packaging

Unit

Box

This product requires application dedicated firmware, which can be downloaded from the Sentera website: Select your application via www.sentera.eu/en/solutions.

First, connect all required products including the Sentera internet gateway. Then connect your installation to www.senteraweb.eu. Click "Link to solution" and enter the solution code to download the selected firmware into the connected devices. After the download there is the possibility to use the installation stand alone or to keep the internet gateway connected.

For more information about the Modbus registers, please refer to the product Modbus Register Map.

# Global trade item numbers (GTIN) DRM-M-02 05401003018729

05401003504277

S.A.3.1.6 www.sentera.eu DS-DRM-M-02-EN-000 - 12 / 09 / 24