

HPSA -2

Differential pressure PI controller for damper actuators



The HPSA -2 series are high resolution differential pressure controllers. The integrated PI control with anti-windup function offers the possibility to directly control damper actuators. They are equipped with a fully digital state-of-the-art pressure transducer designed for a wide range of applications. Zero point calibration and Modbus registers reset can be executed via a tact switch. They also feature integrated K-factor and an analogue / modulating output (0–10 VDC / 0–20 mA / 0–100 % PWM). All parameters are accessible via Modbus RTU (3SModbus software or Sensistant).

Key features

- The differential pressure setpoint can be adjusted via Modbus RTU
- Built-in digital high resolution differential pressure sensor
- Air velocity control (by using an external PSET-PTX-200 Pitot tube connection set)
- Variety of operating ranges
- Selectable response time: 0,1–10 s
- Implemented K-factor
- Differential pressure, air volume⁽¹⁾ or air velocity⁽²⁾ control
- Modbus registers reset function (to factory pre-set values)
- Selectable internal voltage source for PWM output: 3,3 / 12 VDC
- Four LED indicators for the status of the controller and the controlled values
- Modbus RTU communication
- Sensor calibration procedure
- Selectable minimum and maximum span
- Selectable analogue / modulating output
- Aluminium pressure connection nozzles



Article codes

Codes	Power supply	Imax	Operating range
HPSAF-1K0 -2	18–34 VDC	75 mA	0–1.000 Pa
HPSAF-2K0 -2			0–2.000 Pa
HPSAG-1K0 -2	15–24 VAC / 18–34 VDC	120 mA / 50 mA	0–1.000 Pa
HPSAG-2K0 -2			0–2.000 Pa

Technical specifications

Selectable analogue / modulating output	0–10 VDC	$R_L \geq 50 \text{ k}\Omega$
	0–20 mA	$R_L \leq 500 \Omega$
	0–100 % PWM	PWM Frequency: 1 kHz, $R_L \geq 50 \text{ k}\Omega$
Minimum differential pressure range span	50 Pa	
Minimum volume flow range span	10 m ³ /h	
Minimum air velocity range span	1 m/s	
Operating modes	Differential pressure	
	Air volume	
	Air velocity	
Accuracy	±2 % of the operating range	
Protection standard	IP65 (according to EN 60529)	
Enclosure	ASA, grey (RAL9002)	
Ambient conditions	Temperature	-5–65 °C
	Rel. humidity	< 95 % rH (non-condensing)

Wiring and connections

Article type	HPSAF	HPSAG	
Vin	18–34 VDC	18–34 VDC	13–26 VAC
GND	Ground	Common ground*	AC ~*
A	Modbus RTU (RS485), signal A		
/B	Modbus RTU (RS485), signal /B		
AO1	Analogue / modulating output (0–10 VDC / 0–20 mA / PWM)		
GND	Ground AO1	Common ground*	
Connections	Cable cross section		1,5 mm ²

***Attention!** The -F version of the product is not suited for 3-wire connection. It has separate grounds for power supply and analogue output. Connecting both grounds together might result in incorrect measurements. Minimum 4 wires are required to connect -F type sensors.

The -G version is intended for 3-wire connection and features a 'common ground'. This means that the ground of the analogue output is internally connected with the ground of the power supply. For this reason, -G and -F types cannot be used together on the same network. Never connect the common ground of -G type articles to other devices powered by a DC voltage. Doing so might cause permanent damage to the connected devices.

Area of use


- Differential pressure, air velocity⁽¹⁾ or volume flow ⁽²⁾ measurement in HVAC applications
- Overpressurizing applications: clean rooms to avoid particle contamination or staircases for fire safety
- Underpressurizing applications: restaurant kitchens and biohazard laboratories
- Volume flow application: ensuring the minimum legal ventilation rate (m³/h) for buildings

⁽¹⁾ Only when K-factor of fan / drive is known. If K-factor is unknown, volume flow can be calculated via multiplying the duct cross-sectional area (A) by the air velocity (V) using the formula: $Q = A \cdot V$.


⁽²⁾ By using an external PSET-PTX-200 Pitot tube connection set

HPSA -2


Differential pressure PI controller for damper actuators

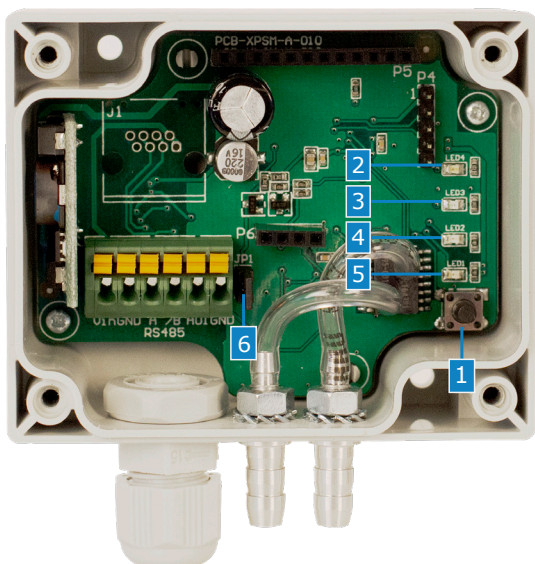

Operational diagram

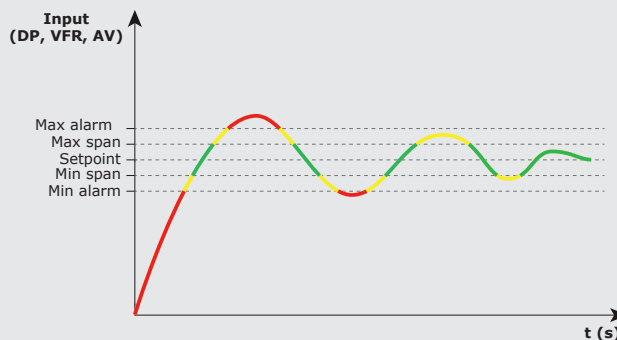

Fixing and dimensions

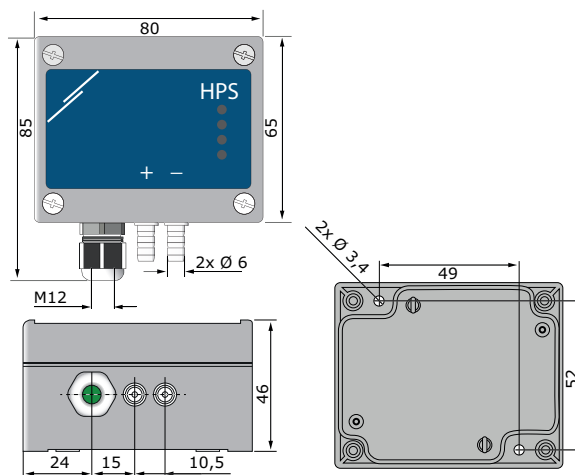

Settings

1 - Sensor calibration and Modbus register reset tact switch		Push to start the Modbus RTU register factory reset or the sensor calibration
2 - Red LED4	On	Measured value out of range
3 - Yellow LED3	On	Measured differential pressure, air volume or air velocity (depending on the selected setpoint) is in out of the setpoint span
4 - Green LED2	On	Measured differential pressure, air volume or air velocity (depending on the selected setpoint) is within the setpoint span
5 - Green LED1	On	Power OK; active Modbus RTU communication
6 - Internal pull-up resistor jumper JP1	*	Connection to internal voltage source

* indicates closed position of the jumper.

Modbus registers



The Sensistant Modbus configurator allows you to easily monitor and/or configure Modbus parameters.

The parameters of the unit can be monitored / configured through the 3SModbus software platform. You can download it from the following link:

<https://www.sentera.eu/en/3SMCenter>



For more information about the Modbus registers, please refer to the product Modbus Register Map.


Standards




- Low Voltage Directive 2014/35/EC
 - EN 60529:1991 Degrees of protection provided by enclosures (IP Code) Amendment AC:1993 to EN 60529
 - EN 60730-1:2011 Automatic electrical controls for household and similar use - Part 1: General requirements
- EMC Directive 2014/30/EC
 - EN 60730-1:2011 Automatic electrical controls for household and similar use - Part 1: General requirements
 - EN 61000-6-1:2007 Electromagnetic compatibility (EMC) - Part 6-1: Generic standards - Immunity for residential, commercial and light industrial environments
 - EN 61000-6-3:2007 Electromagnetic compatibility (EMC) - Part 6-3: Generic standards - Emission standard for residential, commercial and light-industrial environments. Amendments A1:2011 and AC:2012 to EN 61000-6-3
 - EN 61326-1:2013 Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 1: General requirements
 - EN 61326-2-3:2013 Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 2-3: Particular requirements - Test configuration, operational conditions and performance criteria
- WEEE Directive 2012/19/EC
- RoHS Directive 2011/65/EC

HPSA -2


Differential pressure PI controller for damper actuators

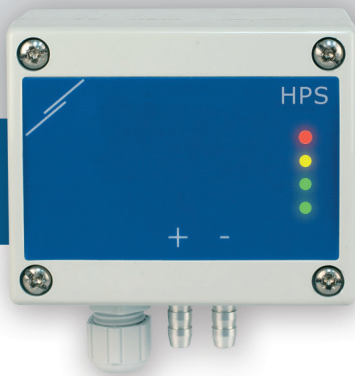


Application 1: Controlling air volume flow [m³/h] using PSET-PVC

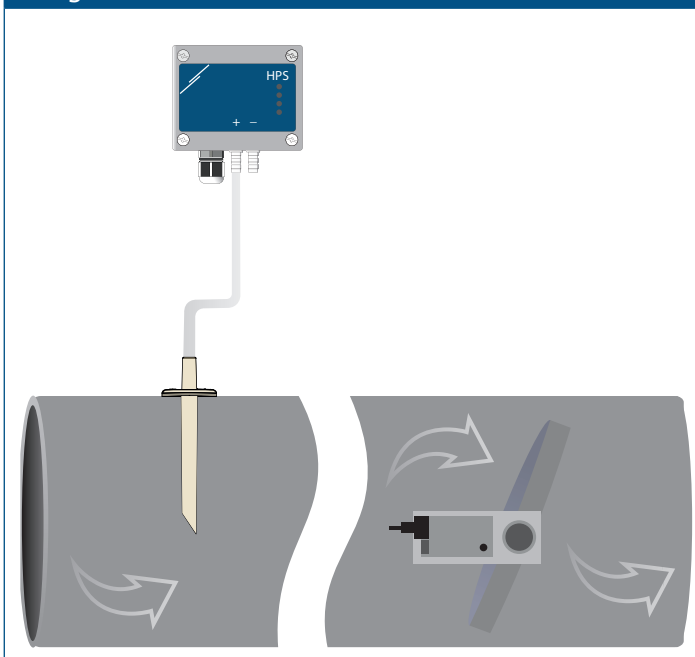

Application 2: Controlling air volume flow [m³/h] or airflow velocity [m/s] using PSET-PT

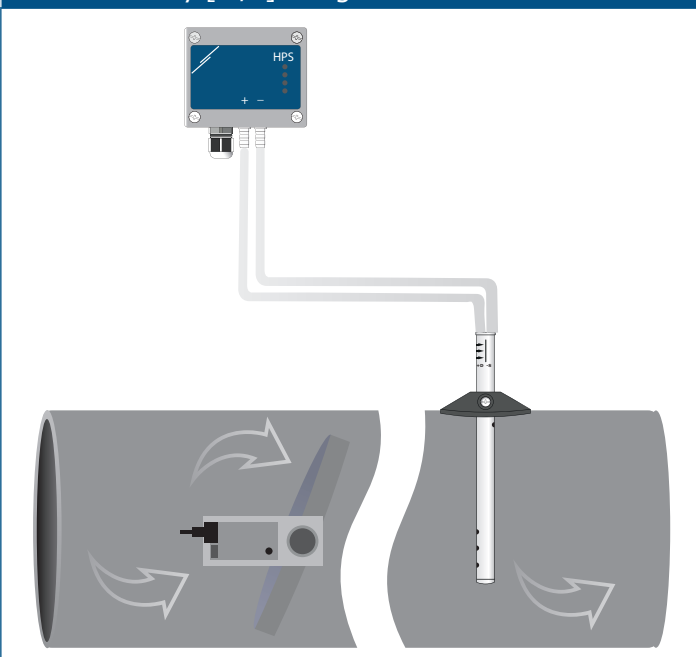

Packaging



Article	Packaging	Length [mm]	Width [mm]	Height [mm]	Net weight	Gross weight
HPSA -2	Unit (1 pc.)	95	85	70	0,12 kg	0,13 kg
	Carton (10 pcs.)	495	185	87	1,20 kg	1,30 kg
	Box (60 pcs.)	590	380	280	7,2 kg	7,8 kg

Global trade item numbers (GTIN)

Packaging	HPSAF-1K0 -2	HPSAF-2K0 -2	HPSAG-1K0 -2	HPSAG-2K0 -2
Unit	05401003017616	05401003017623	05401003017630	05401003017647
Carton	05401003302323	05401003302330	05401003302347	05401003302354
Box	05401003503423	05401003503430	05401003503447	05401003503454