

RSMFH-3

Multifunctional CO₂ room transmitter



The RSMFH-3 series are multifunctional room transmitters which measure CO₂ concentration levels, temperature, relative humidity and ambient light. They have three analogue / modulating outputs for temperature, relative humidity and CO₂ and 24 VDC power supply. Through Modbus RTU, all parameters are accessible.

Key features

- Spring contact terminal block or RJ45 connection
- Selectable temperature, relative humidity and CO₂ ranges
- 3 selectable analogue / modulating outputs
- A bootloader for firmware updates using Modbus RTU communication
- Ambient light sensor with adjustable 'active' and 'standby' level
- Modbus RTU communication
- 3 LEDs with adjustable light intensity for status indication
- Long-term stability and accuracy

Area of use

- Monitoring indoor temperature, relative humidity and CO₂ levels in HVAC applications
- Suitable for residential and commercial buildings
- For indoor use only

Article codes

Article code	Supply	Imax	Connection type
RSMFH-3	24 VDC	60 mA	RJ45 or terminal block

Technical specifications

3 analogue / modulating outputs	0—10 VDC mode	min. load resistance 50 kΩ (R _L ≥ 50 kΩ)
	0—20 mA mode	max. load resistance 500 Ω (R _L ≤ 500 Ω)
	PWM (open-collector type) mode	1 kHz, min. load resistance 50 kΩ (R _L ≥ 50 kΩ), PWM voltage level: 3,3 VDC or 12 VDC
Typical range of use	Temperature	0—50 °C
	Relative humidity	0—95 % rH (non-condensing)
	CO ₂ range	400—2.000 ppm
Accuracy		±0,5 °C (5—50 °C)
		±6 % rH (20—80 % rH)
	400—2.000 ppm CO ₂	±(50 ppm + 3 % of the reading)
	2.001—5.000 ppm CO ₂	±(40 ppm + 5 % of the reading)
Protection standard		IP30 (according to EN 60529)

How to configure



Via a Sentera Internet Gateway you can connect your installation to the SenteraWeb HVAC cloud and:

- Easily change the parameter settings of the connected devices remotely
- Define users and give them access to monitor the installation via a standard web browser
- Log data - create diagrams and export logged data
- Receive alerts or warnings when measured values exceed alert ranges or when errors occur
- Create different regimes for your ventilation system - e.g. day-night regime

Please refer to the Modbus Register Map of the product for more details regarding the Modbus registers.



Wiring diagram

RJ45 socket (Power over Modbus)

Pin 1	24 VDC	Supply voltage
Pin 2		
Pin 3	A	Modbus RTU communication, signal A
Pin 4		
Pin 5	/B	Modbus RTU communication, signal /B
Pin 6		
Pin 7	GND	Ground, supply voltage
Pin 8		



Terminal Block 1

VIN	Supply voltage 24 VDC
GND	Supply voltage, ground
A	Modbus RTU communication, signal A
/B	Modbus RTU communication, signal /B

Terminal Block 2

AO1	Analogue / modulating output 1 for temperature measurement (0—10 VDC / 0—20 mA / PWM)
GND	Ground AO1
AO2	Analogue / modulating output 2 for relative humidity measurement (0—10 VDC / 0—20 mA / PWM)
GND	Ground AO2
AO3	Analogue / modulating output 3 for CO ₂ measurement (0—10 VDC / 0—20 mA / PWM)
GND	Ground AO3


Attention! The unit needs to be supplied via the RJ45 connector or via the connection terminals. Do not connect the device via the RJ45 connector and the terminal block simultaneously.





RSMFH-3

Multifunctional CO₂ room transmitter

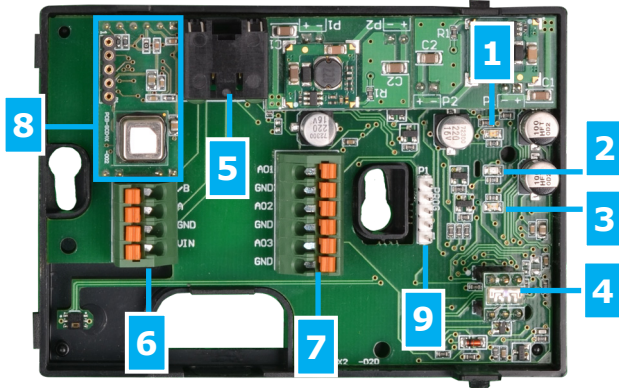




Settings and indications




1 - Red LED	On	Measured temperature or relative humidity values are out of range or CO ₂ is higher than or equal to Alert 2 level
	Blinking	Communication with one of the sensors fails
2 - Yellow LED	On	Measured temperature or relative humidity values are in the alert range or CO ₂ is higher than or equal to Alert 1 level
	Blinking	Modbus communication has stopped and Holding register 8 is activated (Modbus timeout > 0 seconds)
3 - Green LED	On	Measured temperature, relative humidity or CO ₂ values are within range
4 - Ambient light sensor		Low light intensity / Active / Standby
5 - RJ45 socket		Modbus communication with connected Master devices and PoM voltage supply (24 VDC) Blinking LEDs indicate that packages are transmitted via Modbus RTU communication
6 - Terminal block input connection		24 VDC supply voltage and Modbus RTU signal
7 - Output connection		AO1 - temperature measurement
		AO2 - relative humidity measurement
		AO3 - CO ₂ measurement
8 - CO ₂ sensor element		To measure CO ₂ concentration, self-calibrating
9 - PROG header, P1		Put a jumper on pins 1 and 2 and wait for at least 5 seconds to reset the Modbus communication parameters
		Put a jumper on pins 3 and 4 and restart the supply to enter bootloader mode

Note: By default, the LED indicators visualise the measured CO₂ level. When the sensor is in bootloader mode, the green and yellow LEDs flash alternately. During the firmware download, the red LED is flashing additionally.


Operational diagrams

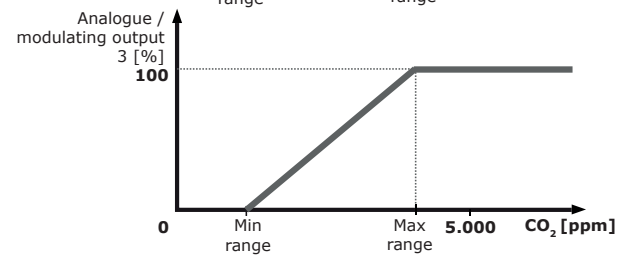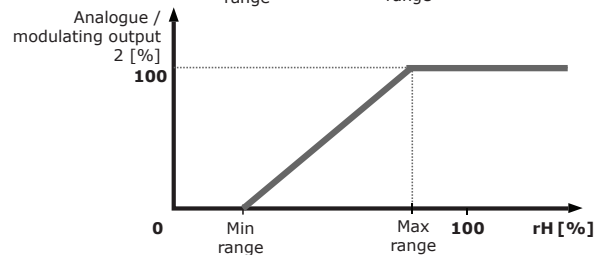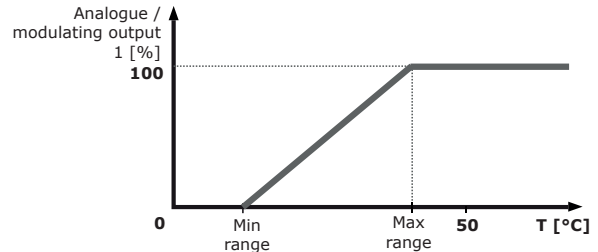

LED indication of CO₂ sensor (default setting)

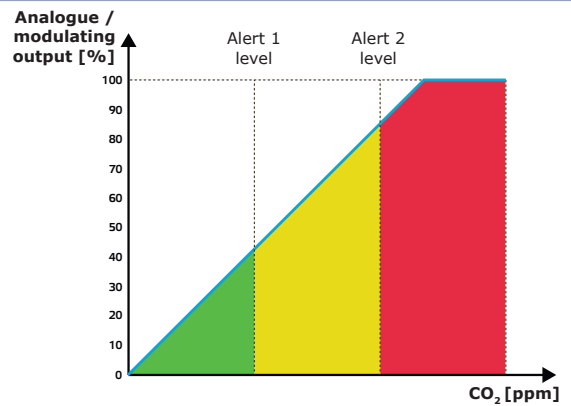

LED indication of temperature and humidity sensor

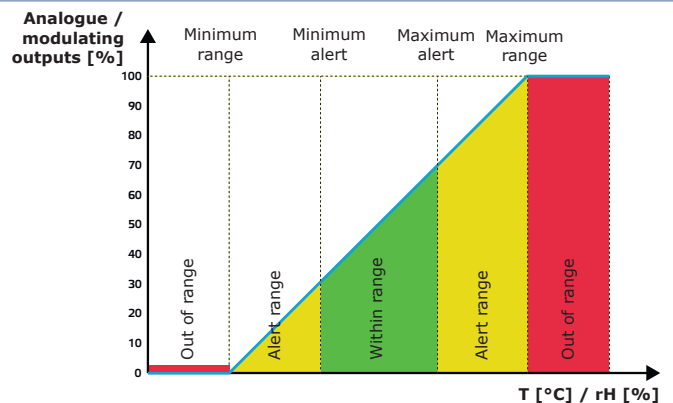




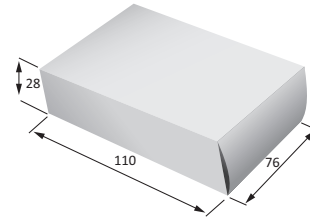
RSMFH-3

Multifunctional CO₂ room transmitter

Standards


- Low Voltage Directive 2014/35/EU 
 - EN 60529:1991 Degrees of protection provided by enclosures (IP Code) Amendment AC:1993 to EN 60529
 - EN 60730-1:2011 Automatic electrical controls for household and similar use - Part 1: General requirements
- EMC Directive 2014/30/EU
 - EN 60730-1:2011 Automatic electrical controls for household and similar use - Part 1: General requirements
 - EN 61000-6-1:2007 Electromagnetic compatibility (EMC) - Part 6-1: Generic standards - Immunity for residential, commercial and light industrial environments
 - EN 61000-6-3:2007 Electromagnetic compatibility (EMC) - Part 6-3: Generic standards - Emission standard for residential, commercial and light-industrial environments Amendments A1:2011 and AC:2012 to EN 61000-6-3
 - EN 61326-1:2013 Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 1: General requirements
 - EN 61326-2-3:2013 Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 2-3: Particular requirements Test configuration, operational conditions and performance criteria for transmitters with integrated or remote signal conditioning.
- WEEE 2012/19/EU
- RoHS Directive 2011/65/EU
 - EN IEC 63000:2018 Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances

Packaging



Article	Packaging	Length [mm]	Width [mm]	Height [mm]	Net weight	Gross weight
RSMFH-3	Unit (1 pc.)	110	76	28	0,097 kg	0,11 kg
	Carton (24 pcs.)	492	177	85	2,328 kg	2,79 kg
	Box (144 pcs.)	590	380	505	13,968 kg	17,73 kg

Fixing and dimensions

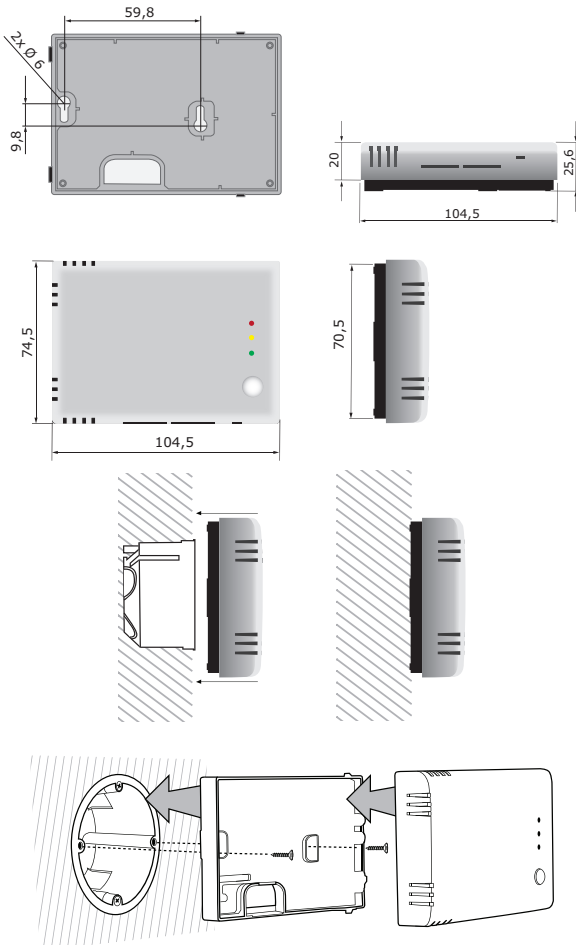

Global trade item numbers (GTIN)

Packaging	RSMFH-3
Unit	05401003018866
Carton	05401003302958
Box	05401003504383